

LED Tracklight FOCUS S-15W-940-40D



Light Output Ratio:	100.0%	
Luminaire Power:	15.49 W	
SHR Nominal:	0.50	Calculated using the TM5
SHR Maximum:	0.60	fine grid method.

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Meng Yongjian
Test Date: 2017-07-31


γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.288
Humidity: 52%
Test Distance: 5.850m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:220.8V I:0.0754A P:15.49W PF:0.9308 Lamp Flux:1043.6x1 lm		
NAME: FOCUS S-15W-940-40D	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: ϕ 70mm*H138mm	
MFR.: NEKO LIGHTING AG		

DATA OF LAMP		PHOTOMETRIC DATA Eff: 67.36 lm/W			
MODEL	CITIZEN-4000K	I _{max} (cd)	2078	S/MH (C0/180)	0.58
NOMINAL POWER (W)	15	LOR (%)	100.0	S/MH (C90/270)	0.56
RATED VOLTAGE (V)	220	TOTAL FLUX (lm)	1043.6	η UP, DN (C0-180)	0.0, 51.9
NOMINAL FLUX (lm)	1043.6	CIE CLASS	DIRECT	η UP, DN (C180-360)	0.0, 48.1
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.50
TEST VOLTAGE (V)	220	η down (%)	100.0	CIBSE SHR MAX	0.60

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

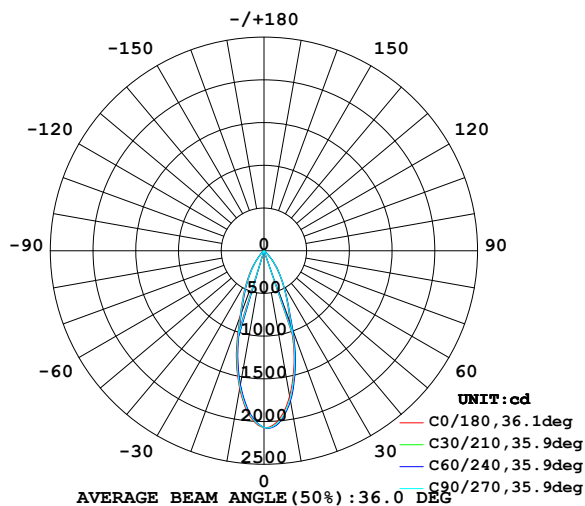

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

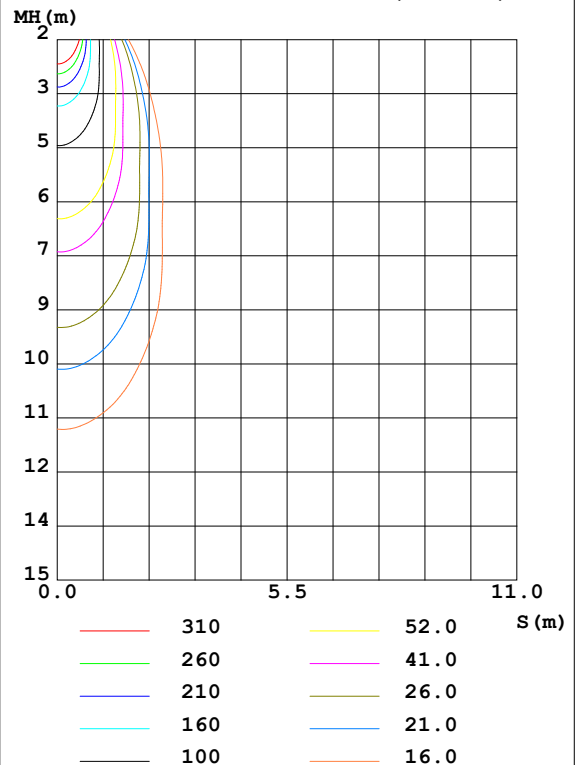


C Range: 0 - 360DEG
 C Interval: 15.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Meng Yongjian
 Test Date: 2017-07-31

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.288
 Humidity: 52%
 Test Distance: 5.850m [K=1.0000]
 Remarks:

**ZONAL FLUX DIAGRAM
AND LUMINANCE LIMITATION CURVES**

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1728	1789	1765	1616	1640	1584	1620	1757	0- 10	178.6	178.6	17.1,17.1
20	922.6	990.9	954.0	799.2	824.4	770.8	800.2	955.1	10- 20	354.3	532.9	51.1,51.1
30	432.3	459.2	446.0	377.2	382.1	350.4	362.2	440.8	20- 30	276.5	809.4	77.6,77.6
40	156.2	181.2	175.8	127.7	127.9	98.18	102.9	155.0	30- 40	162.8	972.2	93.2,93.2
50	28.70	33.82	32.87	24.77	25.25	21.60	22.02	28.63	40- 50	51.09	1023	98.1,98.1
60	8.705	9.850	9.939	7.970	8.041	6.925	6.962	8.880	50- 60	14.13	1037	99.4,99.4
70	2.730	3.269	3.459	2.501	2.409	1.727	1.765	2.774	60- 70	5.090	1043	99.9,99.9
80	0.2254	0.2469	0.2539	0.1704	0.1463	0.1401	0.1310	0.2035	70- 80	0.9486	1043	100,100
90	0.0568	0.0678	0.0918	0.0634	0.0328	0.0328	0.0328	0.0372	80- 90	0.1157	1044	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

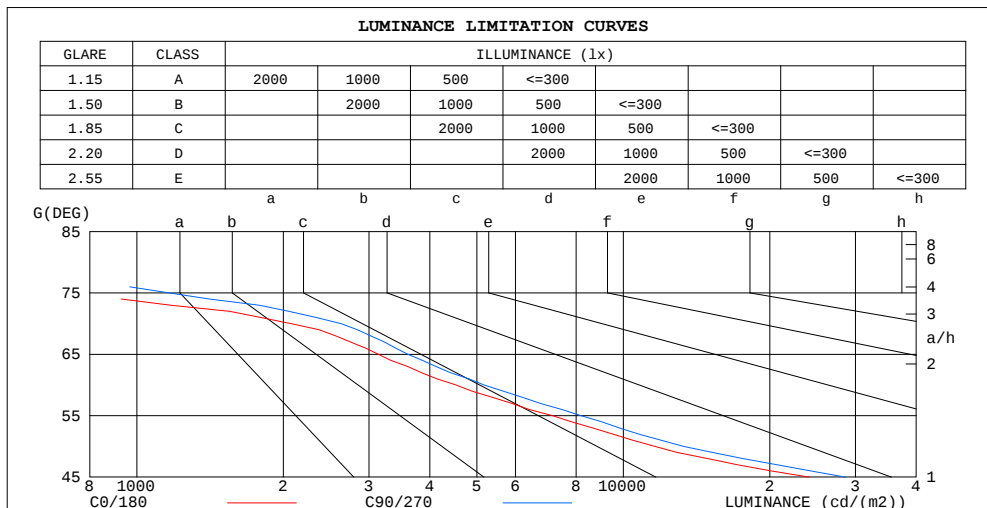

LUMINANCE cd/(m2)		
G(°)	C0/180	C90/270
85	373	490
80	338	380
75	799	1166
70	2075	2630
65	3135	3605
60	4526	5168
55	7154	8182
50	11608	13296
45	24098	28610


C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Meng Yongjian
Test Date:2017-07-31

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.288
Humidity:52%
Test Distance:5.850m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:220.8V I:0.0754A P:15.49W PF:0.9308 Lamp Flux:1043.6x1 lm		
NAME: FOCUS S-15W-940-40D	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: $\varnothing 70\text{mm} \times H138\text{mm}$	
MFR.: NEKO LIGHTING AG		

ρ_{CC}	80%			70%			50%			30%			10%			0
ρ_W	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.11	1.09	1.07	1.09	1.07	1.05	1.05	1.03	1.02	1.01	1.00	.99	.98	.97	.96	.94
2.0	1.04	1.00	.97	1.03	.99	.96	.99	.97	.94	.96	.94	.92	.94	.92	.90	.89
3.0	.98	.93	.90	.97	.92	.89	.94	.90	.87	.92	.89	.86	.89	.87	.85	.83
4.0	.92	.87	.83	.91	.86	.83	.89	.85	.82	.87	.84	.81	.85	.82	.80	.78
5.0	.87	.82	.78	.86	.81	.77	.84	.80	.77	.83	.79	.76	.81	.78	.75	.74
6.0	.82	.77	.73	.82	.76	.73	.80	.76	.72	.79	.75	.72	.78	.74	.71	.70
7.0	.78	.73	.69	.78	.72	.69	.76	.72	.68	.75	.71	.68	.74	.70	.68	.66
8.0	.74	.69	.65	.74	.69	.65	.73	.68	.65	.72	.68	.64	.71	.67	.64	.63
9.0	.71	.65	.62	.70	.65	.62	.69	.65	.61	.69	.64	.61	.68	.64	.61	.60
10.0	.68	.62	.59	.67	.62	.59	.66	.62	.59	.66	.61	.58	.65	.61	.58	.57

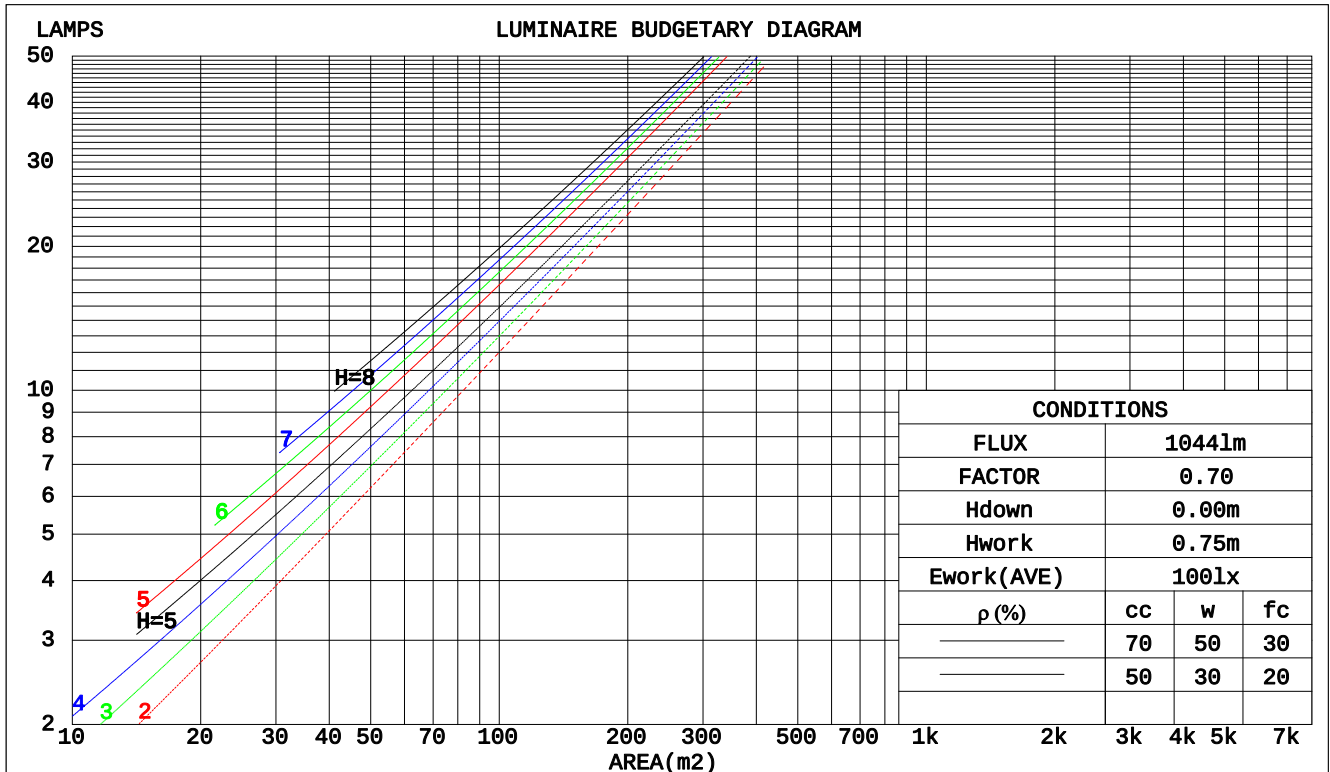

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Meng Yongjian
Test Date:2017-07-31

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.288
Humidity:52%
Test Distance:5.850m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:220.8V I:0.0754A P:15.49W PF:0.9308 Lamp Flux:1043.6x1 lm		
NAME: FOCUS S-15W-940-40D	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: $\varnothing$ 70mm*H138mm	
MFR.: NEKO LIGHTING AG		

ρ _{cc}	80%			70%			50%			30%			10%			0	
ρ _w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ _{fc}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.167	.095	.030	.161	.092	.029	.148	.085	.027	.137	.079	.025	.126	.073	.024		
2.0	.159	.087	.027	.154	.085	.026	.143	.080	.025	.134	.075	.023	.125	.071	.022		
3.0	.151	.081	.024	.147	.078	.024	.138	.075	.023	.129	.071	.022	.122	.067	.021		
4.0	.144	.075	.022	.140	.073	.022	.132	.070	.021	.125	.067	.020	.118	.064	.020		
5.0	.137	.070	.020	.133	.068	.020	.126	.066	.019	.120	.063	.019	.115	.061	.018		
6.0	.130	.065	.019	.127	.064	.018	.121	.062	.018	.116	.060	.018	.111	.058	.017		
7.0	.124	.061	.017	.122	.061	.017	.116	.059	.017	.112	.057	.017	.107	.056	.016		
8.0	.119	.058	.016	.116	.057	.016	.112	.056	.016	.108	.054	.016	.104	.053	.015		
9.0	.114	.055	.015	.112	.054	.015	.108	.053	.015	.104	.052	.015	.100	.051	.015		
10.0	.109	.052	.015	.107	.052	.014	.103	.051	.014	.100	.050	.014	.097	.049	.014		

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.170	.157	.146	.146	.135	.125	.100	.093	.087	.057	.054	.050	.018	.017	.016	
2.0	.155	.133	.114	.132	.114	.099	.091	.079	.069	.052	.046	.040	.017	.015	.013	
3.0	.142	.113	.091	.121	.098	.079	.083	.068	.055	.048	.040	.033	.015	.013	.011	
4.0	.131	.099	.074	.112	.085	.064	.077	.059	.045	.045	.035	.027	.014	.011	.009	
5.0	.122	.087	.061	.105	.075	.053	.072	.053	.038	.042	.031	.022	.013	.010	.007	
6.0	.114	.077	.051	.098	.067	.045	.068	.047	.032	.039	.028	.019	.013	.009	.006	
7.0	.107	.070	.043	.092	.060	.038	.064	.042	.027	.037	.025	.016	.012	.008	.005	
8.0	.101	.063	.037	.087	.055	.032	.060	.039	.023	.035	.023	.014	.011	.007	.005	
9.0	.096	.058	.032	.083	.050	.028	.057	.035	.020	.033	.021	.012	.011	.007	.004	
10.0	.091	.054	.028	.079	.047	.025	.055	.033	.018	.032	.019	.010	.010	.006	.003	

C Range: 0 - 360DEG
 C Interval: 15.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Meng Yongjian
 Test Date:2017-07-31

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.288
 Humidity:52%
 Test Distance:5.850m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

Test:U:220.8V I:0.0754A P:15.49W PF:0.9308 Lamp Flux:1043.6x1 lm										
NAME: FOCUS S-15W-940-40D					TYPE:Downlight			SERIAL No.:		
SPEC.:4000K					DIM.: $\phi 70\text{mm} \times H138\text{mm}$					
MFR.: NEKO LIGHTING AG										
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	19.2	20.1	19.5	20.3	20.4	19.6	20.5	19.8	20.7	20.8
3H	19.1	19.9	19.4	20.1	20.3	19.5	20.3	19.8	20.5	20.7
4H	19.0	19.8	19.3	20.0	20.2	19.4	20.2	19.7	20.4	20.6
6H	18.9	19.7	19.2	19.9	20.1	19.3	20.1	19.6	20.3	20.5
8H	18.9	19.6	19.2	19.8	20.1	19.3	20.0	19.6	20.2	20.5
12H	18.9	19.5	19.2	19.8	20.1	19.2	19.9	19.6	20.2	20.4
4H 2H	19.0	19.8	19.3	20.0	20.2	19.4	20.2	19.7	20.4	20.6
3H	18.9	19.6	19.2	19.8	20.1	19.3	20.0	19.6	20.2	20.5
4H	18.8	19.4	19.2	19.7	20.0	19.2	19.8	19.6	20.1	20.4
6H	18.7	19.2	19.1	19.6	19.9	19.1	19.6	19.5	20.0	20.3
8H	18.7	19.2	19.1	19.5	19.9	19.1	19.6	19.5	19.9	20.3
12H	18.6	19.1	19.0	19.4	19.8	19.0	19.5	19.4	19.8	20.2
8H 4H	18.7	19.2	19.1	19.5	19.9	19.1	19.6	19.5	19.9	20.3
6H	18.6	19.0	19.0	19.4	19.8	19.0	19.4	19.4	19.8	20.2
8H	18.5	18.9	19.0	19.3	19.7	18.9	19.3	19.4	19.7	20.1
12H	18.5	18.8	18.9	19.2	19.7	18.9	19.2	19.3	19.6	20.1
12H 4H	18.6	19.1	19.0	19.4	19.8	19.0	19.5	19.4	19.8	20.2
6H	18.5	18.9	19.0	19.3	19.7	18.9	19.3	19.4	19.7	20.1
8H	18.5	18.8	18.9	19.2	19.7	18.9	19.2	19.3	19.6	20.1
Variations with the observer position at spacings:										
S = 1.0H	+ 2.5 / - 8.9					+ 2.6 / - 8.7				
1.5H	+ 4.6 / - 6.6					+ 4.6 / - 6.8				
2.0H	+ 5.2 / - 5.1					+ 5.5 / - 5.4				

CIE Pub.117 Corrected 1044 lm Total Lamp Luminous Flux.(8log(F/F₀) = 0.1)

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Meng Yongjian
Test Date:2017-07-31

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 γ Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.288
Humidity:52%
Test Distance:5.850m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:220.8V I:0.0754A P:15.49W PF:0.9308 Lamp Flux:1043.6x1 lm		
NAME: FOCUS S-15W-940-40D	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: $\varnothing 70\text{mm} \times H138\text{mm}$	
MFR.: NEKO LIGHTING AG		

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	87	81	77	87	81	77	86	80	77	73
0.80	95	89	85	94	89	85	93	88	85	81
1.00	99	94	90	98	93	90	97	93	89	85
1.25	103	98	95	102	98	94	100	96	93	89
1.50	106	101	98	105	101	97	103	99	96	92
2.00	109	105	101	107	103	101	105	102	99	94
2.50	110	107	104	109	105	103	106	103	101	95
3.00	112	108	106	110	107	105	107	104	102	96
4.00	114	111	109	112	109	108	108	106	105	98
5.00	115	113	111	113	111	109	109	108	106	99
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 15.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Meng Yongjian
 Test Date:2017-07-31

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.288
 Humidity:52%
 Test Distance:5.850m [K=1.0000]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:220.8V I:0.0754A P:15.49W PF:0.9308 Lamp Flux:1043.6x1 lm		
NAME: FOCUS S-15W-940-40D	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: ϕ 70mm*H138mm	
MFR.: NEKO LIGHTING AG		

Conical surface Flux(90deg):

1007.1 lm

%lum = 96.5%


%lamp = 96.5%

Conical surface Flux(120deg):

1037.4 lm

%lum = 99.4%

%lamp = 99.4%

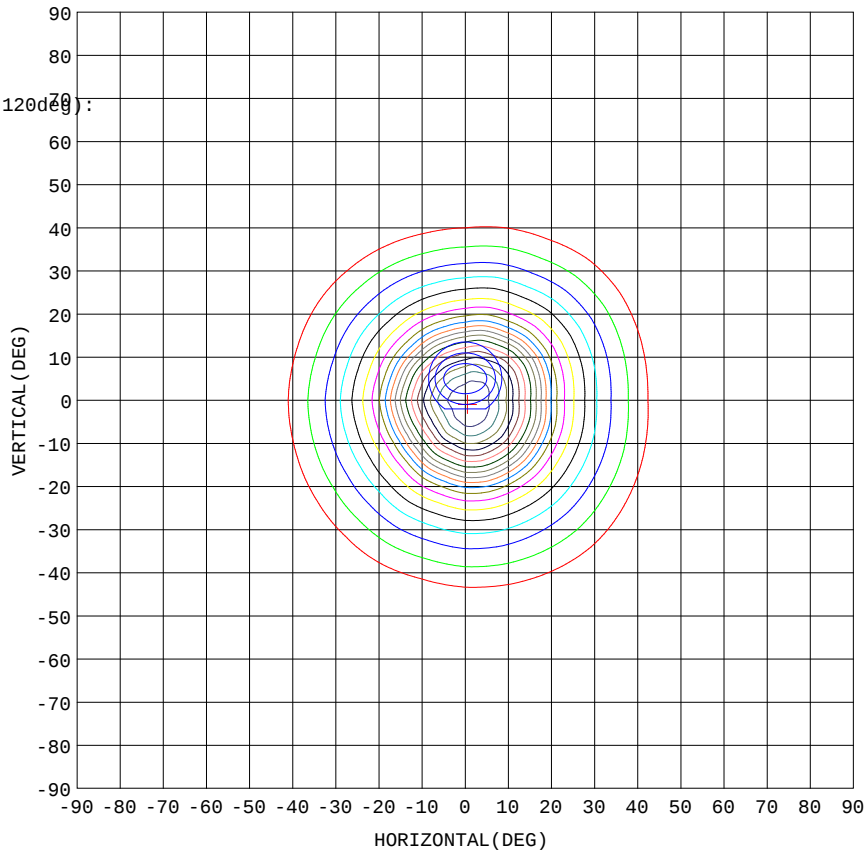

1. AVG=1900, MIN=1705
2. AVG=1861, MIN=1536
3. AVG=1805, MIN=1346

Imax:2077(H0.5,V-1.0)
(At:C=60.0, Gamma=1.0)

UNIT: cd


C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Meng Yongjian
Test Date:2017-07-31

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.288
Humidity:52%
Test Distance:5.850m [K=1.0000]
Remarks:

AAI Figure

Test:U:220.8V I:0.0754A P:15.49W PF:0.9308 Lamp Flux:1043.6x1 lm		
NAME: FOCUS S-15W-940-40D	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: ϕ 70mm*H138mm	
MFR.: NEKO LIGHTING AG		

Flux out:464.6 lm

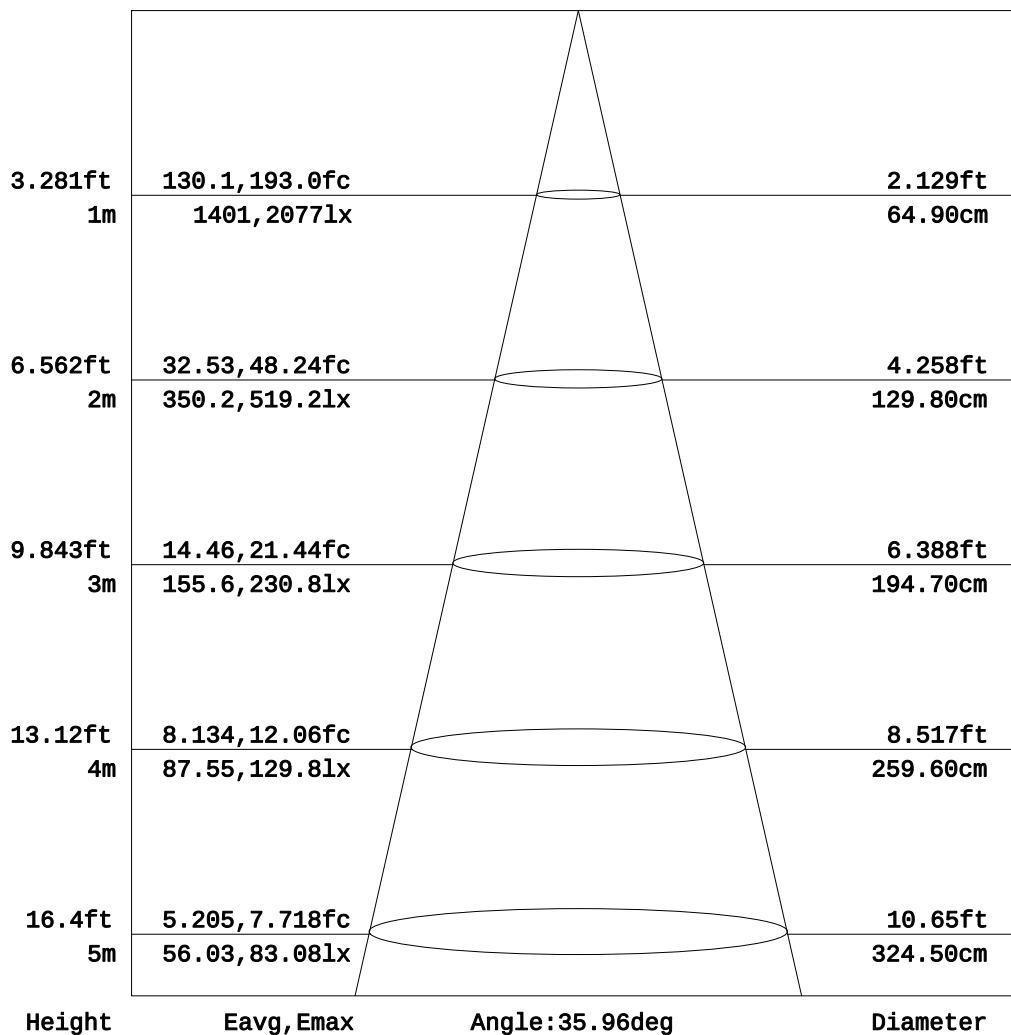


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Meng Yongjian
Test Date:2017-07-31

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.288
Humidity:52%
Test Distance:5.850m [K=1.0000]
Remarks:

ISOLUX DIAGRAM


Test:U:220.8V I:0.0754A P:15.49W PF:0.9308 Lamp Flux:1043.6x1 lm		
NAME: FOCUS S-15W-940-40D	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: ϕ 70mm*H138mm	
MFR.: NEKO LIGHTING AG		

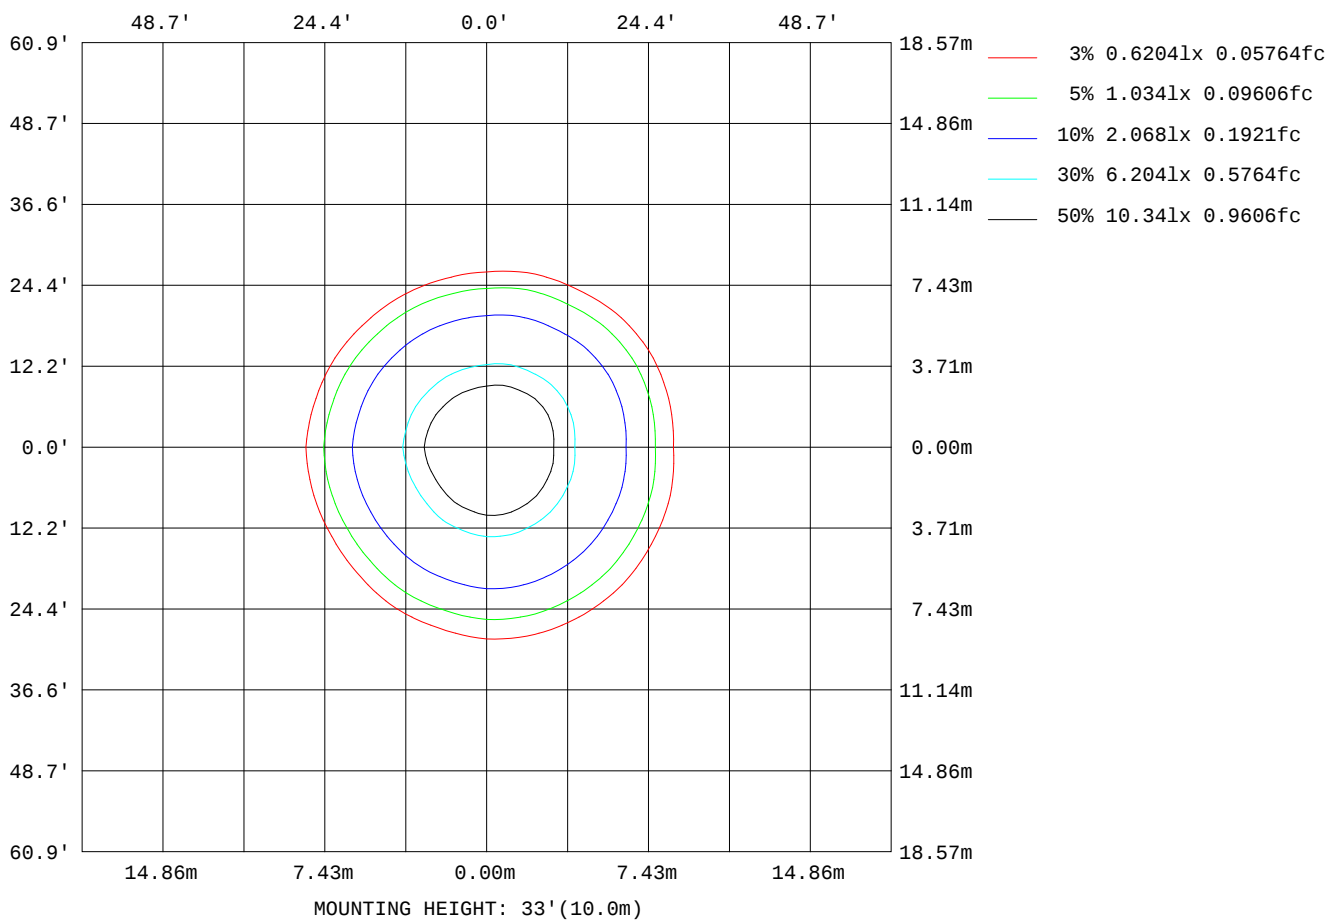

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Meng Yongjian
Test Date:2017-07-31

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 γ Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.288
Humidity:52%
Test Distance:5.850m [K=1.0000]
Remarks:

Planar Illuminance Curve

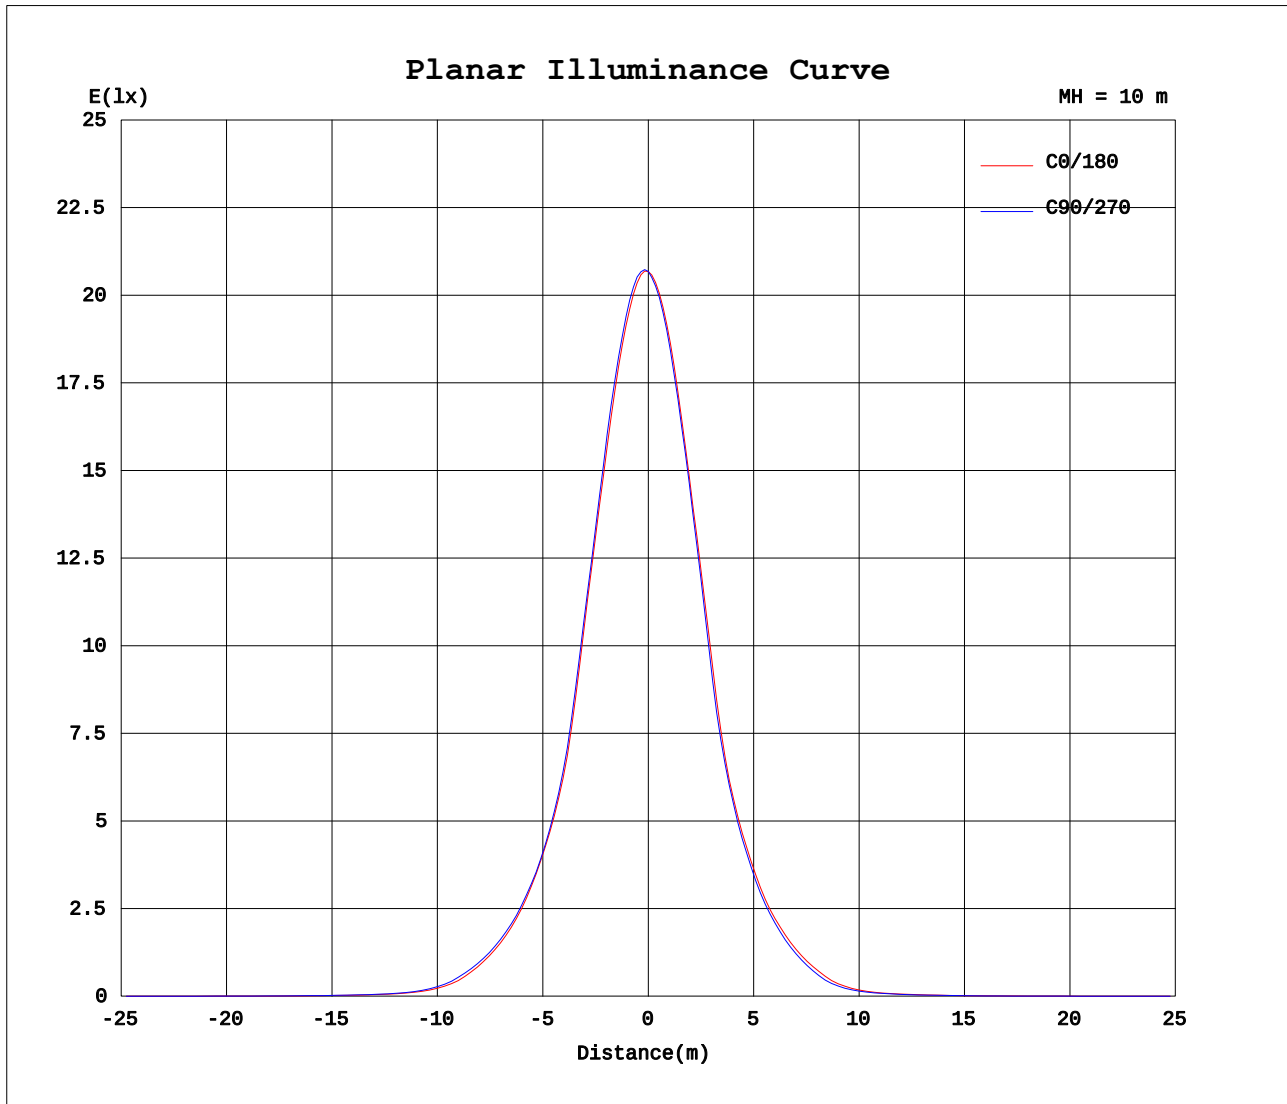

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Meng Yongjian
Test Date: 2017-07-31

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.288
Humidity: 52%
Test Distance: 5.850m [K=1.0000]
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.288
Humidity:52%
Test Distance:5.850m [K=1.0000]
Remarks:

```

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.288
Humidity:52%
Test Distance:5.850m [K=1.0000]
Remarks:

```

Photometric Data Table [cd]

G/C	0.0	15.0	30.0	45.0	60.0	75.0	90.0	105.0	120.0	135.0
0.0	2068	2067	2068	2066	2068	2066	2068	2074	2074	2072
3.0	2044	2056	2060	2067	2067	2067	2061	2042	2032	2008
6.0	1946	1966	1973	1989	1988	1988	1972	1934	1916	1877
9.0	1793	1820	1829	1846	1844	1844	1824	1773	1749	1691
12.0	1588	1619	1631	1657	1652	1652	1620	1553	1525	1462
15.0	1360	1395	1401	1423	1416	1417	1385	1315	1285	1220
18.0	1102	1143	1150	1176	1167	1168	1134	1055	1020	952.9
21.0	843.0	876.0	882.4	905.5	900.6	900.2	871.1	812.6	790.5	738.9
24.0	676.1	693.5	697.9	711.8	708.8	708.5	692.6	648.5	628.6	596.6
27.0	547.5	562.4	563.3	570.1	568.1	566.9	554.6	522.0	509.4	480.6
30.0	432.3	446.6	452.3	459.2	456.7	456.4	446.0	416.6	402.2	377.2
33.0	334.0	346.5	349.7	357.8	357.5	358.5	350.3	325.3	314.5	294.5
36.0	252.3	263.4	268.0	275.7	277.1	277.4	270.1	248.0	238.5	219.2
39.0	179.0	191.5	195.6	204.1	205.0	205.4	198.9	178.3	169.0	150.5
42.0	110.0	124.2	129.6	138.1	140.0	139.4	132.8	111.7	103.0	87.89
45.0	65.54	71.45	75.56	81.78	82.42	82.93	77.82	65.85	61.76	51.71
48.0	38.38	41.96	44.00	47.13	47.19	47.85	45.31	39.36	36.81	31.85
51.0	25.29	27.13	28.01	29.46	29.50	29.97	28.90	25.76	24.47	22.27
54.0	17.67	18.79	19.53	20.53	20.60	21.08	20.40	18.23	17.47	15.92
57.0	12.35	13.07	13.46	14.10	14.26	14.54	14.13	12.91	12.37	11.08
60.0	8.705	9.214	9.466	9.850	9.941	10.14	9.939	9.126	8.808	7.970
63.0	6.292	6.610	6.739	7.058	7.132	7.311	7.194	6.684	6.469	5.942
66.0	4.621	4.830	4.906	5.132	5.225	5.375	5.326	4.999	4.864	4.476
69.0	3.265	3.448	3.523	3.698	3.811	3.934	3.914	3.609	3.462	2.991
72.0	1.844	2.040	2.107	2.264	2.377	2.500	2.440	2.114	1.924	1.480
75.0	0.7959	0.8904	0.9239	1.002	1.035	1.177	1.161	0.9417	0.7828	0.3470
78.0	0.2736	0.2753	0.3072	0.2993	0.3171	0.3037	0.3342	0.2686	0.2541	0.2097
81.0	0.2036	0.2009	0.2298	0.2228	0.2429	0.2272	0.2342	0.1878	0.1883	0.1485
84.0	0.1467	0.1354	0.1665	0.1594	0.1817	0.1573	0.1773	0.1332	0.1300	0.1027
87.0	0.0964	0.0808	0.1139	0.1027	0.1292	0.1026	0.1336	0.0852	0.0986	0.0656
90.0	0.0568	0.0568	0.0722	0.0678	0.0896	0.0700	0.0918	0.0612	0.0700	0.0634

G/C	150.0	165.0	180.0	195.0	210.0	225.0	240.0	255.0	270.0	285.0
0.0	2068	2067	2068	2066	2068	2066	2068	2074	2074	2072
3.0	1998	2003	2014	2000	1998	1990	1993	1992	2002	2028
6.0	1862	1874	1894	1871	1865	1852	1855	1854	1873	1916
9.0	1667	1684	1710	1683	1676	1657	1662	1663	1687	1745
12.0	1440	1460	1492	1460	1454	1431	1438	1439	1469	1538
15.0	1196	1218	1253	1213	1200	1174	1182	1182	1219	1299
18.0	926.2	945.5	981.7	939.1	926.6	903.5	909.2	910.1	940.6	1020
21.0	723.8	736.4	760.4	736.5	730.4	714.9	720.0	720.2	741.8	796.0
24.0	587.5	594.4	612.3	592.7	584.1	572.8	574.0	575.7	591.0	630.7
27.0	469.2	475.9	490.3	470.8	463.8	450.0	450.8	452.3	466.3	506.1
30.0	369.7	372.9	382.1	365.6	359.8	350.4	351.2	351.3	362.2	391.7
33.0	286.8	290.0	297.3	280.3	272.9	265.2	264.8	264.8	273.9	299.4
36.0	211.3	214.5	219.8	205.9	199.1	189.4	188.0	188.0	196.1	218.6
39.0	142.5	145.4	151.1	136.6	130.0	119.2	117.9	117.5	126.1	146.5
42.0	82.92	83.01	87.30	79.05	74.11	68.50	67.33	67.19	71.53	84.78
45.0	47.00	48.81	51.33	45.54	43.12	40.18	39.84	39.66	41.80	49.43
48.0	30.26	30.55	31.82	29.65	28.45	27.23	26.95	26.89	27.73	30.89
51.0	21.45	21.80	22.59	21.11	20.23	19.09	19.01	18.81	19.69	21.89
54.0	15.21	15.50	16.08	14.82	14.15	13.44	13.38	13.29	13.74	15.52
57.0	10.63	10.77	11.28	10.37	9.938	9.535	9.494	9.380	9.647	10.67
60.0	7.688	7.784	8.041	7.519	7.240	6.925	6.854	6.770	6.962	7.581
63.0	5.723	5.796	5.918	5.555	5.344	5.115	5.049	4.992	5.108	5.564
66.0	4.282	4.323	4.410	4.095	3.916	3.712	3.644	3.598	3.712	4.095
69.0	2.782	2.766	2.907	2.571	2.413	2.201	2.140	2.096	2.201	2.602
72.0	1.286	1.279	1.402	1.189	1.068	0.9451	0.8970	0.8811	0.9286	1.167
75.0	0.2961	0.2818	0.3054	0.2706	0.2359	0.2496	0.2337	0.2561	0.2468	0.3181
78.0	0.2145	0.1966	0.1878	0.1948	0.1659	0.1817	0.1637	0.1860	0.1747	0.2166
81.0	0.1554	0.1376	0.1266	0.1335	0.1070	0.1226	0.1026	0.1291	0.1156	0.1510
84.0	0.1160	0.0960	0.0742	0.0898	0.0610	0.0788	0.0588	0.0810	0.0632	0.1007
87.0	0.0832	0.0590	0.0350	0.0504	0.0306	0.0438	0.0328	0.0438	0.0328	0.0591
90.0	0.0656	0.0612	0.0328	0.0328	0.0306	0.0328	0.0328	0.0328	0.0328	0.0328

G/C	300.0	315.0	330.0	345.0
0.0	2074	2072	2068	2069
3.0	2037	2056	2062	2055
6.0	1932	1968	1976	1964
9.0	1768	1819	1837	1820
12.0	1566	1624	1640	1618
15.0	1332	1400	1422	1395
18.0	1061	1141	1169	1143
21.0	820.5	876.3	899.7	877.7

C Range: 0 - 360DEG
 C Interval: 15.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Meng Yongjian
 Test Date: 2017-07-31

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.288
 Humidity: 52%
 Test Distance: 5.850m [K=1.0000]
 Remarks:

Photometric Data Table [cd]

24.0	651.5	696.6	713.0	698.1
27.0	524.5	562.4	576.2	564.1
30.0	405.6	440.8	454.6	447.0
33.0	310.9	339.5	352.4	346.5
36.0	228.4	252.9	266.0	261.2
39.0	157.0	177.9	189.3	186.4
42.0	90.69	108.7	117.7	116.4
45.0	53.07	64.31	67.56	66.76
48.0	32.62	37.65	39.99	39.88
51.0	22.79	25.32	26.78	26.41
54.0	16.17	17.85	18.66	18.28
57.0	11.31	12.51	12.99	12.81
60.0	7.979	8.880	9.220	9.042
63.0	5.796	6.415	6.640	6.531
66.0	4.287	4.736	4.893	4.827
69.0	2.819	3.331	3.495	3.436
72.0	1.399	1.873	2.041	2.007
75.0	0.4593	0.7911	0.8870	0.8676
78.0	0.2031	0.2517	0.2533	0.2714
81.0	0.1375	0.1795	0.1747	0.2013
84.0	0.0830	0.1204	0.1091	0.1357
87.0	0.0393	0.0767	0.0611	0.0854
90.0	0.0306	0.0372	0.0350	0.0415

C Range: 0 - 360DEG
C Interval: 15.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Meng Yongjian
Test Date: 2017-07-31

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.288
Humidity: 52%
Test Distance: 5.850m [K=1.0000]
Remarks: